



LA BUVETTE®

Rue Maurice Périn - Z.I. de Tournes
 08013 CHARLEVILLE-MEZIERES Cedex FRANCE
 Tél. 03.24.52.37.20 - Fax 03.24.52.37.24
 Int. : +33.3.24.52.37.23 - Int. : +33.3.24.52.37.24
 SAV : 03.24.52.37.27 - Fax 03.24.52.37.19
 Internet : www.labuvette.com
 E-mail : commercial@labuvette.com
 sav@labuvette.com

TRANSFORMATEUR TRANSFORMATOREN TRANSFORMER



A-501, A-502, A-503 A-504, A-505

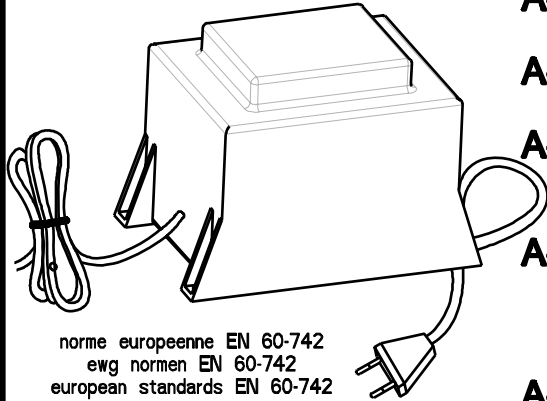

norme europeenne EN 60-742
 ewg normen EN 60-742
 european standards EN 60-742


A-505 50VA → 1 LAKCHO 50 W

A-504 100VA → 2 LAKCHO 50W , 1 ISOBAC


A-503 200VA → 4 LAKCHO 50W, 2 ISOBAC, 1 CALDOLAC 5,
 1 STALL 3000 EL

A-502 400VA → 8 LAKCHO 50W, 4 ISOBAC, 2 CALDOLAC 5,
 2 STALL 3000 EL 150W + 1C 162 22 W
 1 LB 220 EL

A-501 300VA → 6 LAKCHO 50W, 3 ISOBAC, 1 LB 150 EL

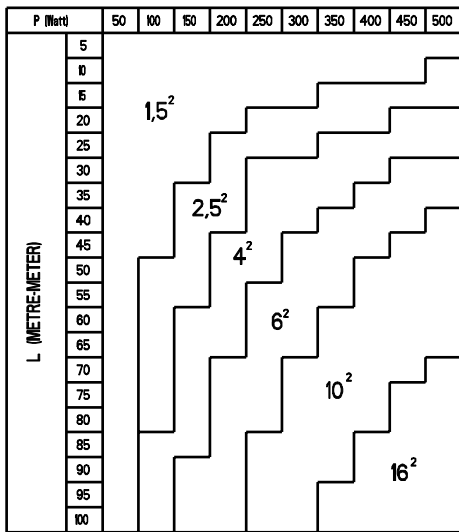


S² : Section du cable
 Kabelquerschnitt (mm²)
 Section of the cable

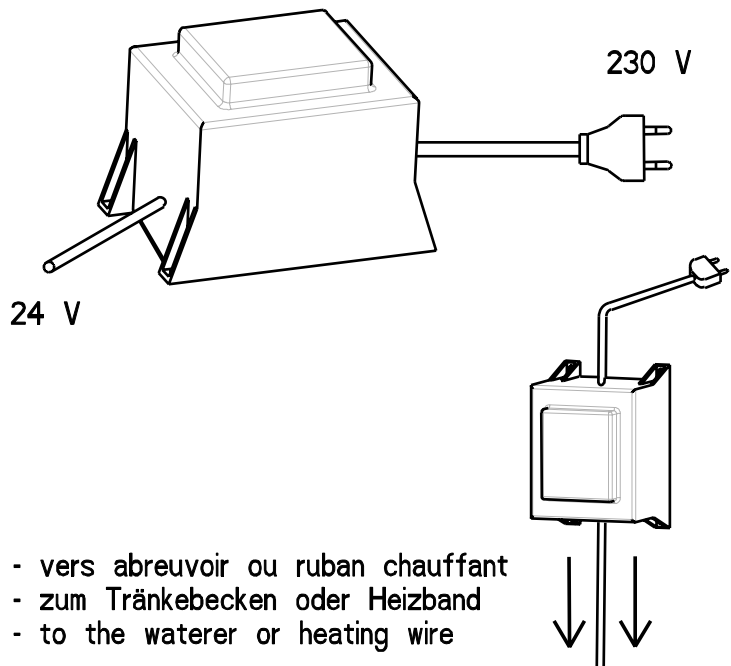

- vers abreuvoir ou ruban chauffant
- zum Tränkebecken oder Heizband
- to the waterer or heating wire

Fusible primaire : aM Fusible secondaire : gG
 Primär Sicherung : aM Sekundär Sicherung : gG
 Primary fuse : aM Secondary fuse : gG

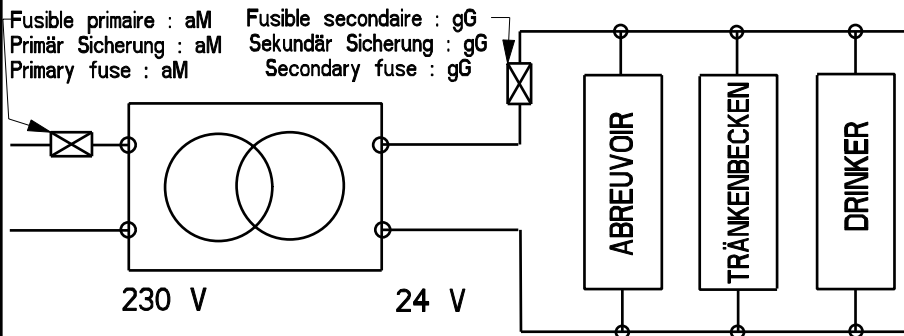

en parallele / parallel connection / parallel

| ATTENTION | ACHTUNG | CAUTION |
|----------------------------------|--------------------------------|---------------------------------|
| PROTECTION PAR FUSIBLES | SICHERUNGEN ERFORDERLICH | PROTECT WITH FUSES |
| PRIMAIRE (aM) P(VA) 230 V | Primär (aM) P(VA) 230 V | PRIMARY (aM) P(VA) 230 V |
| SECONDAIRE (gG) P(VA) 24 V | Sekundär (gG) P(VA) 24 V | SECONDARY (gG) P(VA) 24 V |

P(VA) : puiss. transfo / trafo leistung / transfo power